

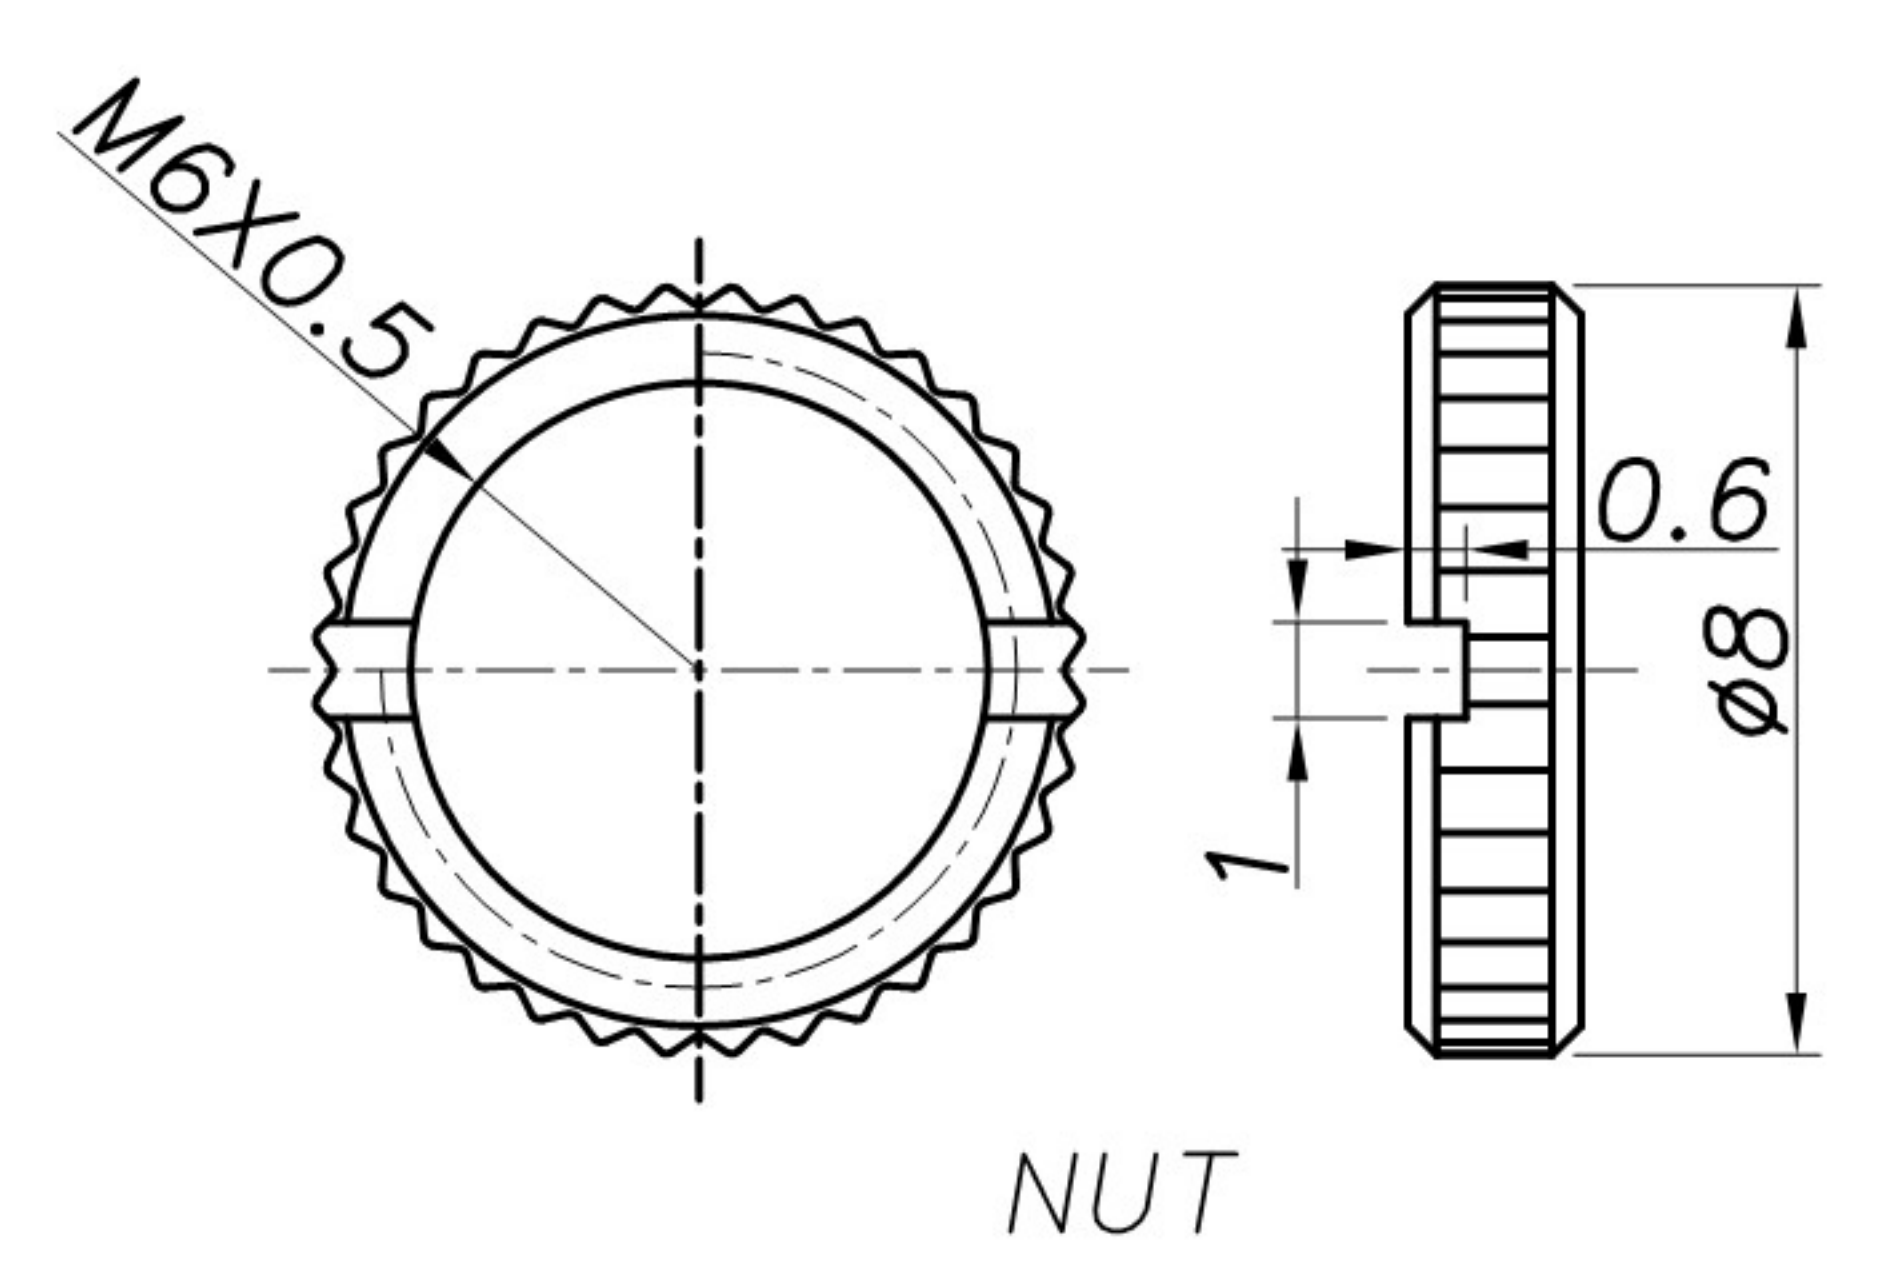
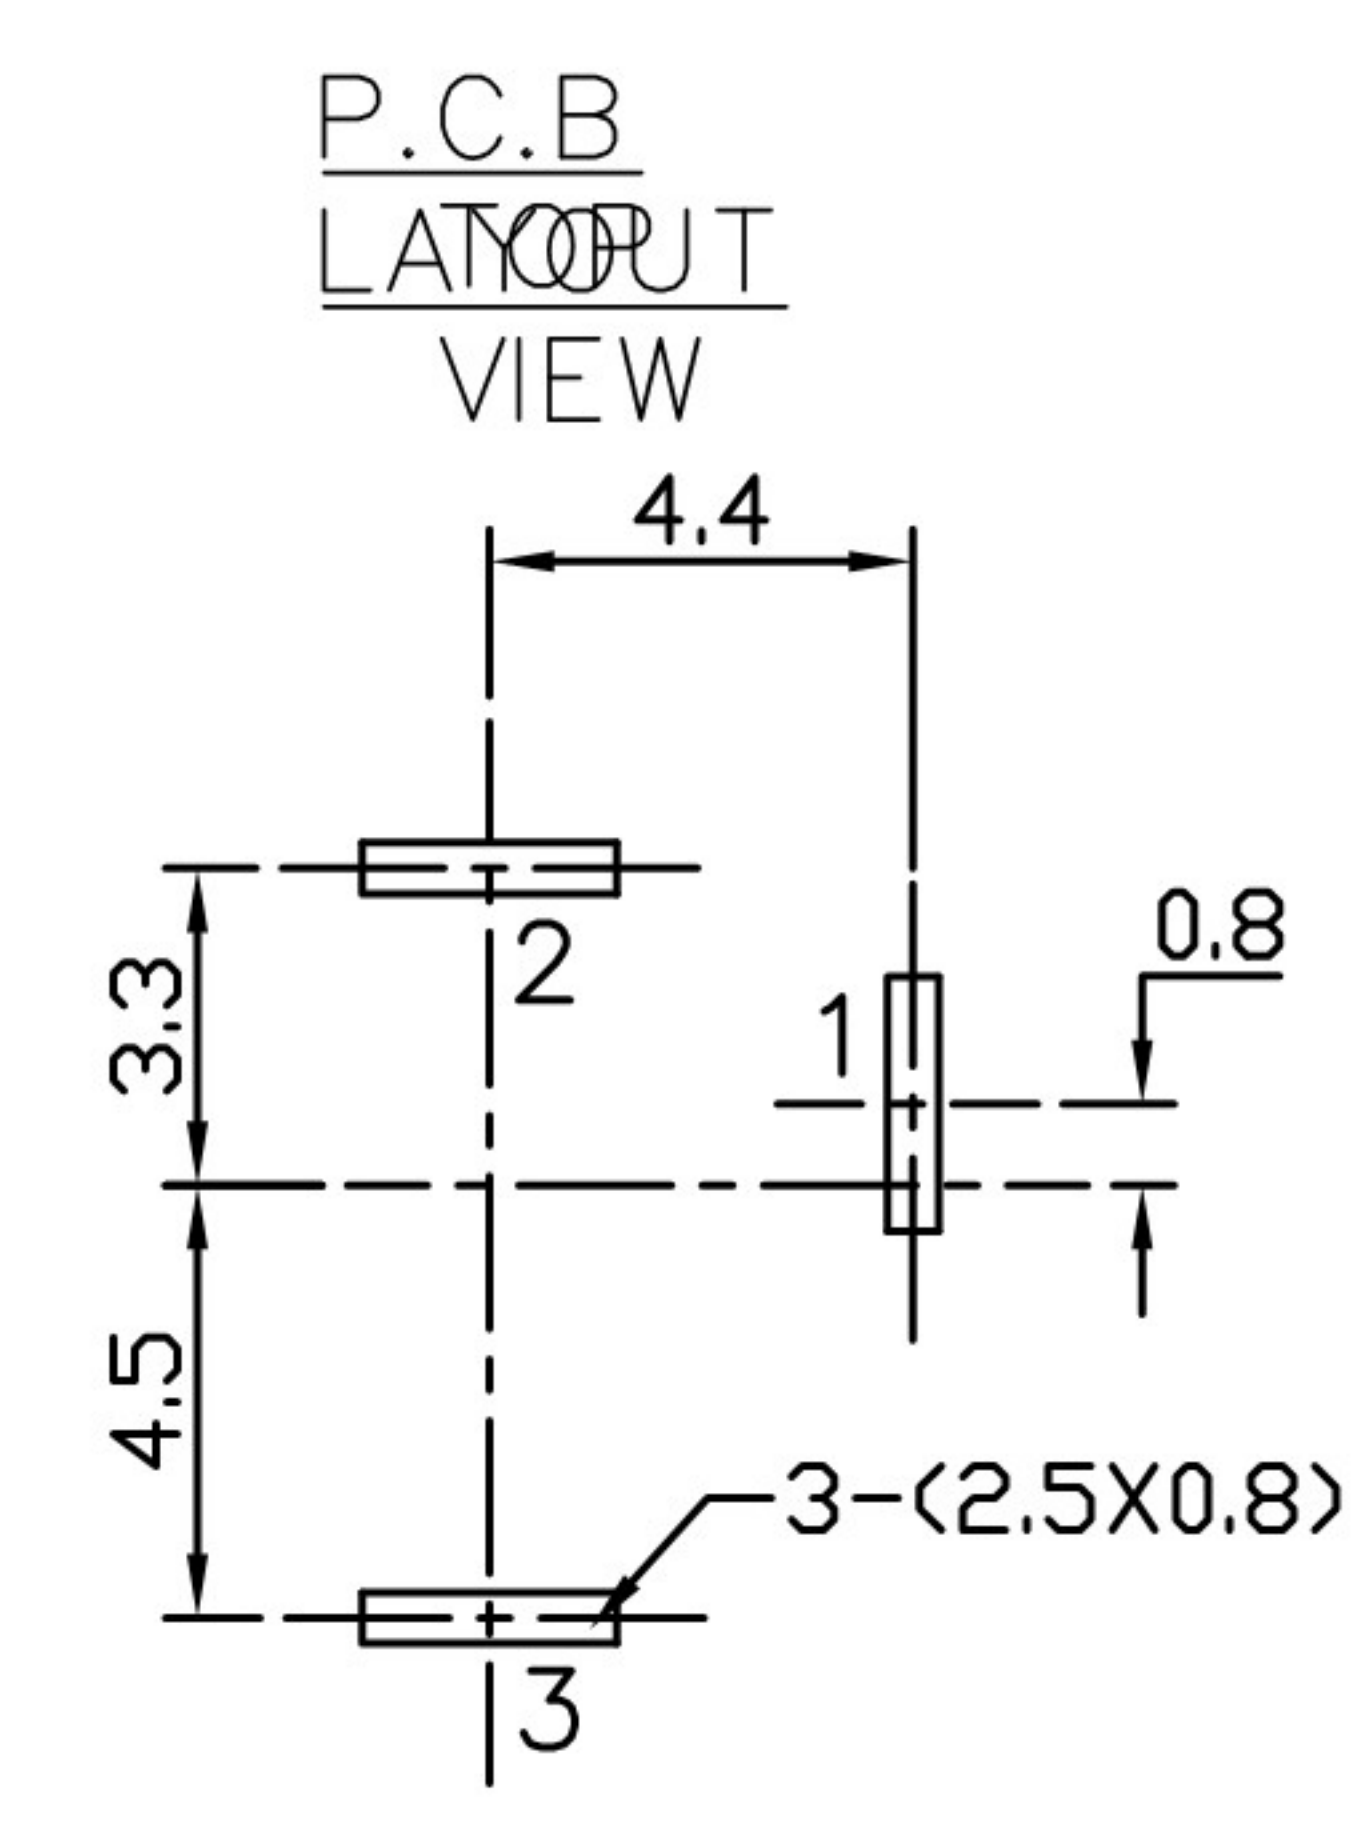
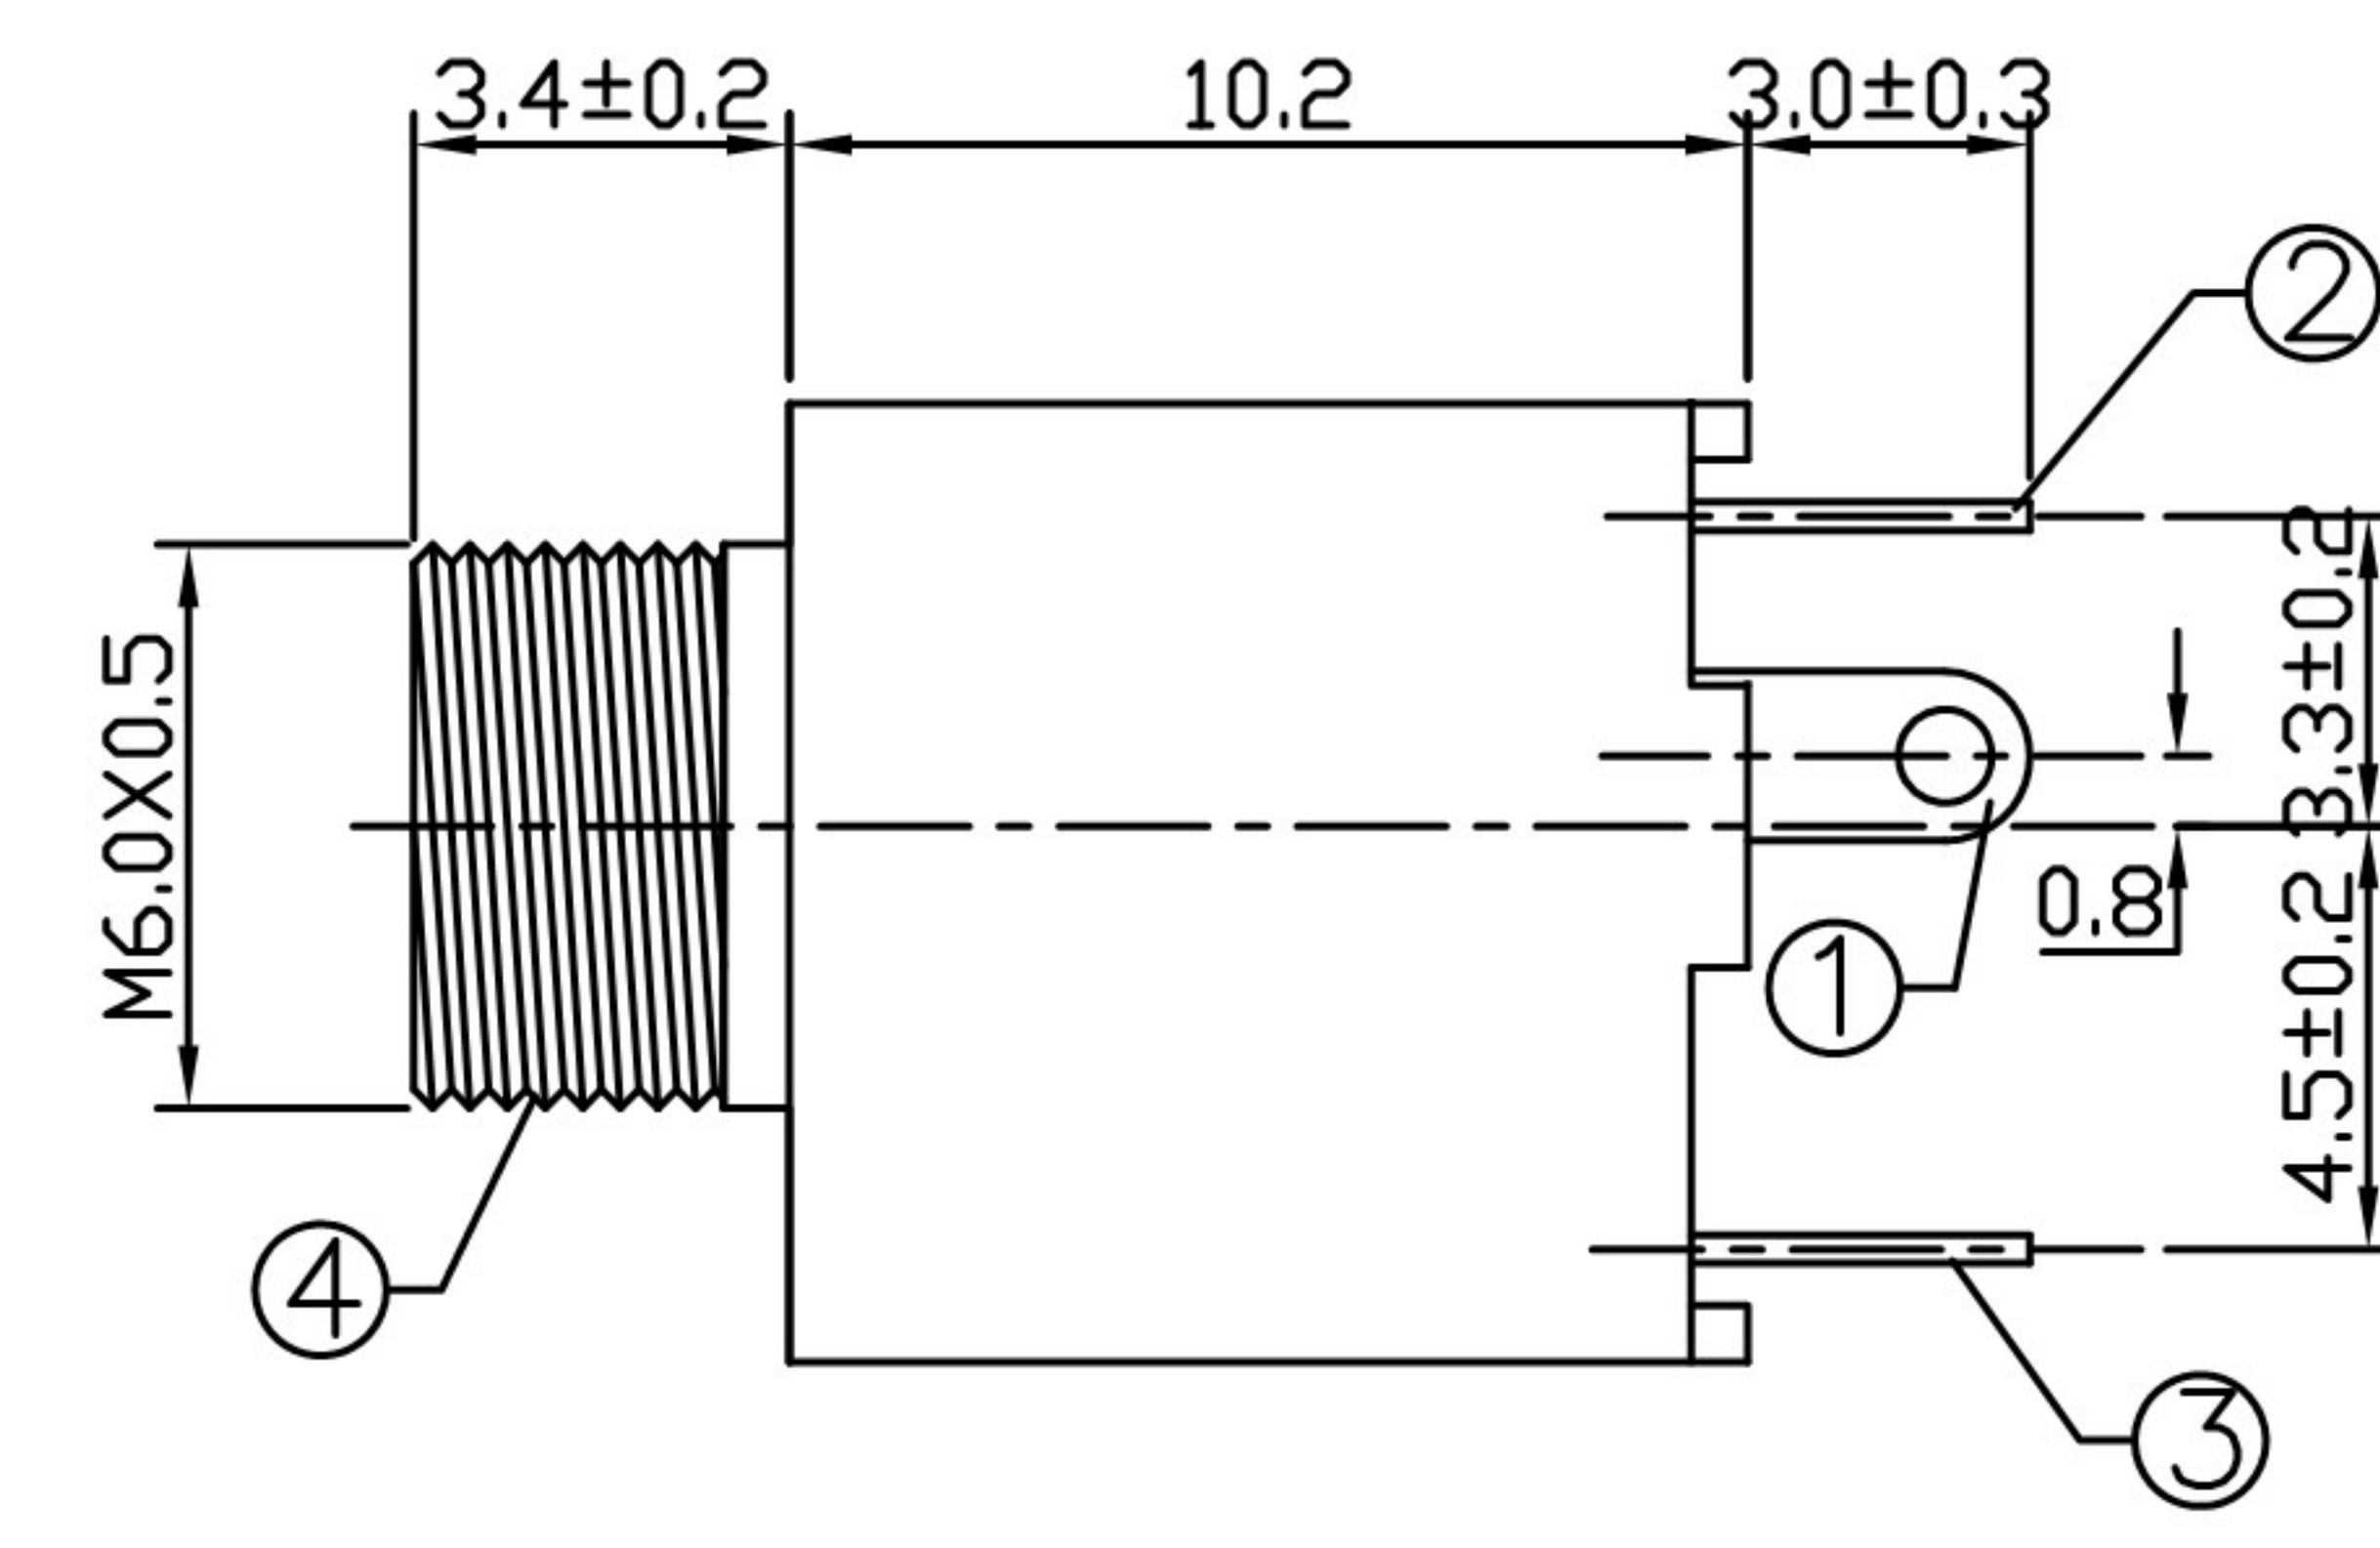


REV.	ECN NO.	DESCRIPTION	DESIGN	DATE
A		INITIAL	Kai	2018.06.14

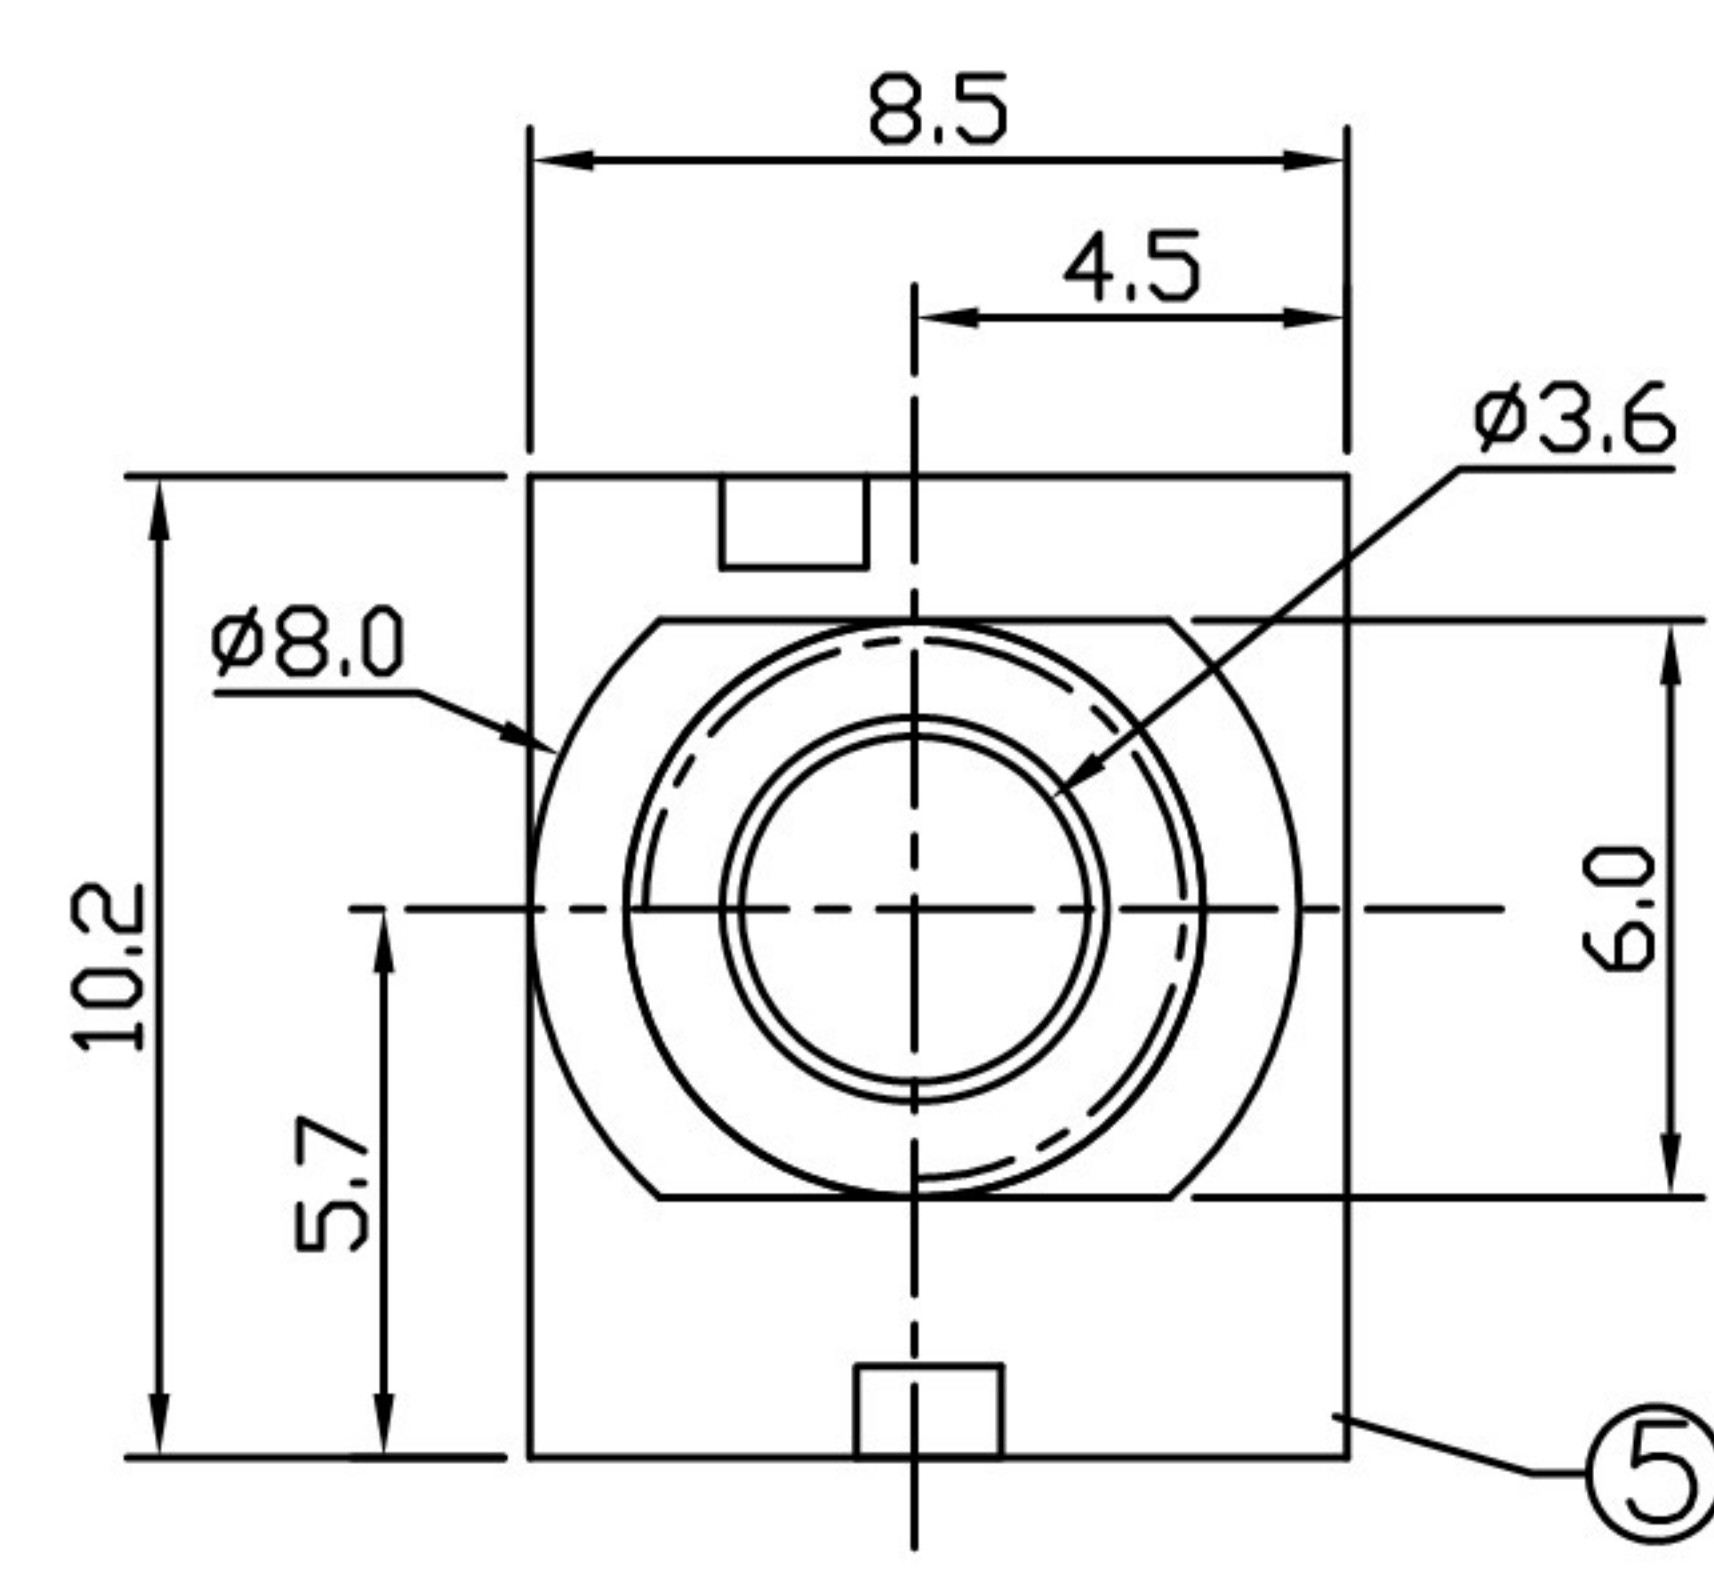

SCHEMATIC

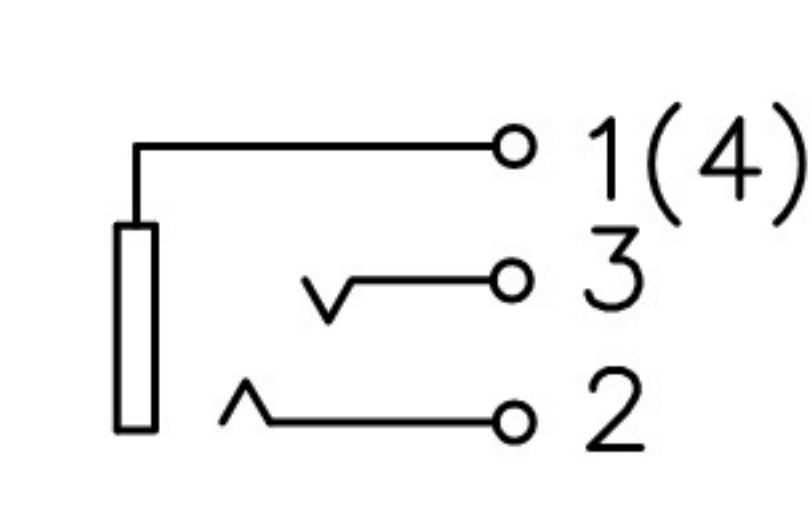

SPECIFICATION

- 1.Rating : DC 30V 0.5A;
- 2.Contact resistance: ≤50mΩ;
- 3.Insulation resistance: ≥100MΩ (DC250V);
- 4.Withstand voltage: 500VAC ;
- 5.Insertion and extraction force: 3–25N;
- 6.life test: 5,000 cycles.

							UNLESS OTHERWISE SPECIFIED TOLERANCES		Switch Connector 东莞市溪榜电子有限公司 DONG GUAN XI BANG ELECTRONICS CO., LTD.							
							DECIMALS:		ANGLES:		DWG NO.		Q/XM-CP-RD-XXXX		PART NAME:	
							DIM		TOL		DIM		TOL		DESIGN:	
							X.		±0.35		X.		±2°		2018.06.14	
							X.X		±0.30		X.X		±1°		Kai	
							X.XX		±0.20		X.XX		—		CHECK:	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	
							X.X		±0.30		X.X		±1°		2018.06.14	
							X.XX		±0.20		X.XX		—		APPROVED	
							X.XXX		±0.10		X.XXX		—		2018.06.14	
							X.		±0.35		X.		±2°		Lucky	

主要技术性能	
额定电负荷	DC 30V\0.5A
接触电阻	≤0.03Ω
绝缘电阻	≥100MΩ
耐 压	AC500V (50Hz)/min
插 拔 力	3-20N
使用温度范围	-30-70℃
使用寿命	5000次

序号	产品编号	产品名称	数量	材 料	规 格	电 镀
4		盖 脚	1	磷 铜	0.25T	镀 银
3		弹片脚	1	镀青铜	0.2T	镀 银
2		中 脚	3	磷 铜	0.2T	镀 银
1		基 座	1	P P A		黑 色